




THIS DETAIL APPLIES FOR LOW VOLTAGE ELECTRIC SERVICE (660 V OR LESS) FROM AN OVERHEAD UTILITY SUPPLY TO SEPERATLY-MOUNTED SERVICE EQUIPMENT.

NOTES

- 1. SERVICE VOLTAGE SHALL BE AS INDICATED ELSEWHERE IN THE DRAWINGS.
- 2. UNLESS OTHERWISE INDICATED, ITEMS AND WORK SHALL BE INCLUDED AND PAID AS PART OF THE ELECTRIC UTILITY SERVICE INSTALLATION PAY ITEM.
- CONDUIT AND CONNECTOR DIAMETER SHALL MATCH THE DIAMETER OF THE SERVICE CONDUCTOR RACEWAY AS INDICATED ON THE PLANS.
- 4. PVC COATED RACEWAYS AND ACCESSORIES SHALL BE CAREFULLY INSTALLED WITH MFR RECOMMENDED TOOLS AND PROCEDURES TO AVOID DAMAGE. ANY DAMAGE SHALL BE REPAIRED WITH COMPATIBLE PVC TOUCH-UP MATERIAL TO THE SATISFACTION OF THE ENGINEER OR THE DAMAGED MATERIAL SHALL BE REPLACED AT NO ADDITIONAL COST.
- 5. THE CONTRACTOR SHALL OBTAIN INSPECTION AND APPROVAL BY THE ENGINEER OF SERVICE RISER GROUND ELECTRODE, RISER ELBOW, NIPPLE AND CONNECTION TO SERVICE CONDUCTOR RACEWAY EXTENSION BEFORE BACKFILL AND SHALL ALSO OBTAIN INSPECTION OF SERVICE RISER AND SEALING BUSHING BEFORE UTILITY "U" GUARD INSTALLATION AND SERVICE CONNECTION.
- 6. THE HORIZONTAL ELECTRIC SERVICE CONDUCTOR RACEWAY SHALL BE AS INDICATED AND SHALL BE MEASURED SEPARATELY FOR PAYMENT. WHEN THE RACEWAY IS PVC-COATED RIGID GALVANIZED STEEL, THE COUPLING SHALL BE THE SAME. WHEN THE RACEWAY IS PVC CONDUIT (IN CONCRETE), THE COUPLING SHALL BE A METALIC TO NON METALIC ADAPTER. WHEN THE RACEWAY IS ENCASED IN CONCRETE, THE CONCRETE SHALL EXTEND TO COVER THE COUPLING.
- 7. PLANS AND DETAILS INDICATE THE GENERAL NATURE AND REQUIREMENTS. THEY DO NOT SHOW EVERY ACCESSORY AND ATTACHMENT, AND THEY DO NOT RELIEVE THE CONTRACTOR OF THE REQUIREMENTS OF THE SPECIFICATIONS AND SPECIAL PROVISIONS TO ASCERTAIN UTILITY REQUIREMENTS AND TO COORDINATE ACCORDINGLY, FURNISHING ALL ITEMS AND WORK NOT PROVIDED BY THE UTILITY, BUT NECESSARY FOR A COMPLETE SERVICE INSTALLATION IS REQUIRED AND SHALL BE INCLUDED IN THE ELECTRIC UTILITY SERVICE INSTALLATION PAY ITEM.

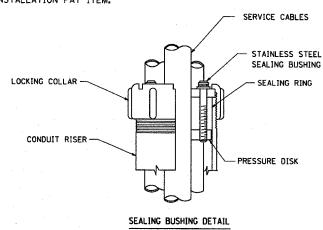

REVISIONS
NAME
DATE

LLLINOIS DEPARTMENT OF TRANSPORTATION

ELECTRIC SERVICE INSTALLATION
AERIAL, REMOTE DISCONNECT
BE - 220

SCALE: NONE
DATE: 1/9/2007
CHECKED BY MEA

REVISION DATE: 01/01/07

DATE = 1/9/2807 NAME : citypojests/datata/ba228.dgn STAME = databad / IN.

UTILITY POLE, PRIMARY CUT-OUTS TRANSFORMER(S) (AS APPLICABLE) BY THE ELECTRIC UTILITY. THE CONTRACTOR SHALL COORDINATE AS REQUIRED. 0 0 0 PROVIDE ADEQUATE SLACK FOR DRIP LOOP AND CONNECTION ASCERTAIN AND BY THE UTILITY ASSURE CLEARANCE FROM UTILITY SECONDARY SPACE, NON-METALLIC "U" GUARD. AS APPLICABLE. FURNISH FOR INSTALLATION UTILITY GROUND CONNECTION, BY ELECTRIC UTILITY, LENGTH (AS APPLICABLE), BY UTILITY UTILITY GROUND, AS APPLICABLE, (BY UTILITY) CONDUIT/CONDUCTOR
SEALING BUSHING, SIZE AND
CONDUCTOR CONFIGURATION TO MATCH SERVICE. OZ GEDNEY TYPE CSBG OR APPROVED EQUAL, COMPLETE WITH LOCKING COLLAR (SEE DETAIL) -2-HOLE STRAP FOR RIGID CONDUIT. ZINC PLATED STEEL O.Z. GEDNEY TYPE TH-1800 OR APPROVED EQUAL. ATTACHED WITH LAG SCREWS. (TYPICAL) APPROXIMATELY 10'-6" (3.2 m) RIGID STEEL CONDUIT RISER (CONTINUOUS 10' (3 m) LENGTH). -HEAVY DUTY GROUND CLAMP, UNIVERSAL U-CLAMP TYPE, BY O.Z. GEDNEY, T&B OR APPROVED EQUAL. RIGID GALVANIZED THREADED COUPLING. -PVC-COATED RIGID CONDUIT NIPPLE OR CONDUIT EXTENSION, LENGTH AS REQUIRED APPROX. 6" (150 mm) GRADE-EXOTHERMIC WELD CONNECTION 30" MIN - 36" MAX (762.0 mm MIN. - 914.0mm MAX.) PVC COATED RIGID CONDUIT ELBOW 24" (609.6mm) RADIUS (MIN.) SEE NOTE 3. TO TOP OF CONDUIT EXTENSION TO SERVICE EQUIPMENT -HORIZONTIAL ELECTRIC SERVICE THREADED TRANSITION COUPLING. CONDUCTOR RACEWAY (SEE NOTE 6) AS APPLICABLE (SEE NOTE 6) GROUNDING ELECTRODE CONDUCTOR. BARE COPPER, #1/O AWG. MINIMUM GROUND ROD SHALL BE INSTALLED NOT LESS THAN 24" (609 mm) FROM POLE UNLESS APPROVED BY THE ENGINEER UTILITY GROUNDING ELECTRODE-(AS APPLICABLE), BY UTILITY CUSTOMER SERVICE RISER GROUND ELECTRODE 5%" X 10' (15.875 mm X 3.048 m) COPPERCLAD GROUND ROD (IN UNDISTURBED SOIL) SEE NOTE 5.